

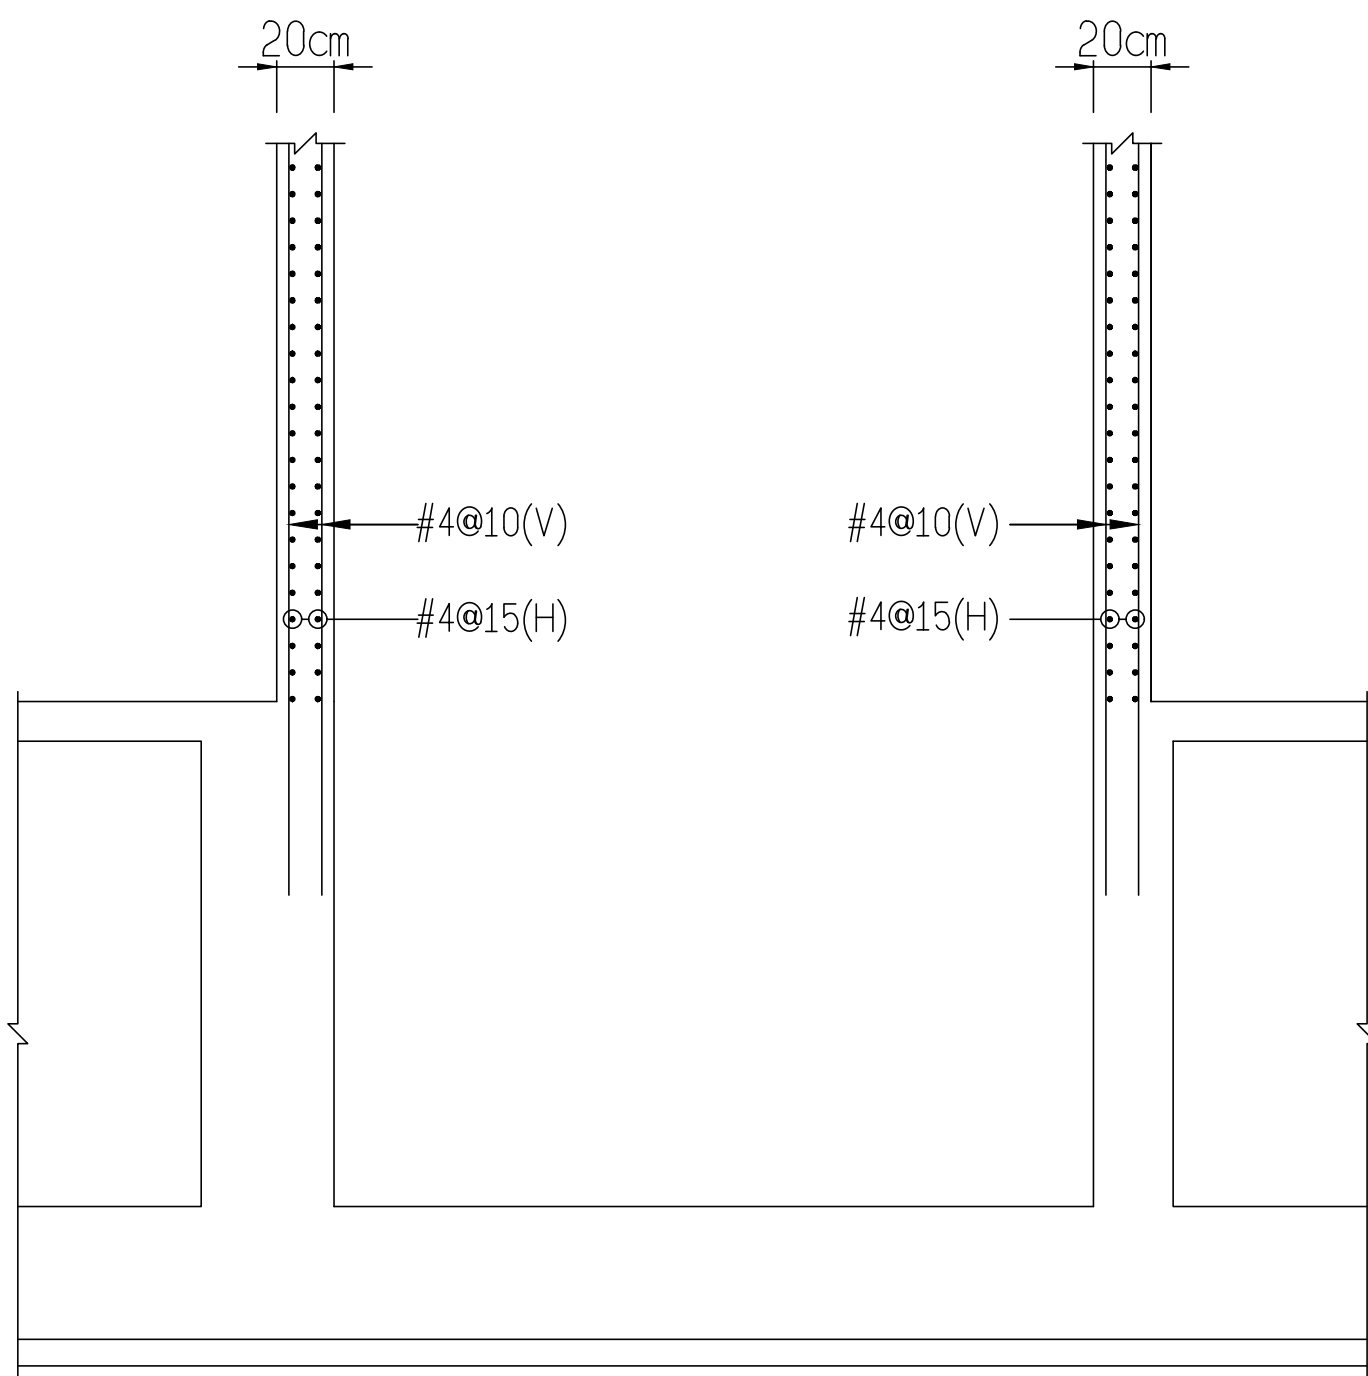


樓板配筋表


樓板編號	TYPE	板 厚	配 筋 A	配 筋 B
FS1	B	80	#5@10	#5@10
FS2	B	80	#6@15	#6@15
FS3	B	80	#6@12	#6@12
FS3A	B	105	#6@12	#6@12
FS4	B	80	#6@10	#6@10
FS5	B	80	#7@10	#7@10
S1	A	15	#4@12	#4@20
S2	A	15	#4@15	#4@15
S3	A	15	#3@10	#3@15
S4	A	15	#3@20	#3@20
S5	A	25	#3@15	#3@15
S6	A	15	#3@15	#3@20
S7	A	15	#3@18	#3@18
S8	A	15	#4@10	#4@15
S9	A	15	#4@15	#4@20
S10	A	15	#3@12	#3@12
ES1	A	25	#4@15	#4@15
ES2	A	25	#4@12	#4@12
SS1	A	25	#5@12	#5@12
WS1	A	20	#4@12	#4@12
CS1	C	25	#5@12	#5@20
CS2	C	15	#4@10	#4@20
CS3	C	15	#3@10	#3@20

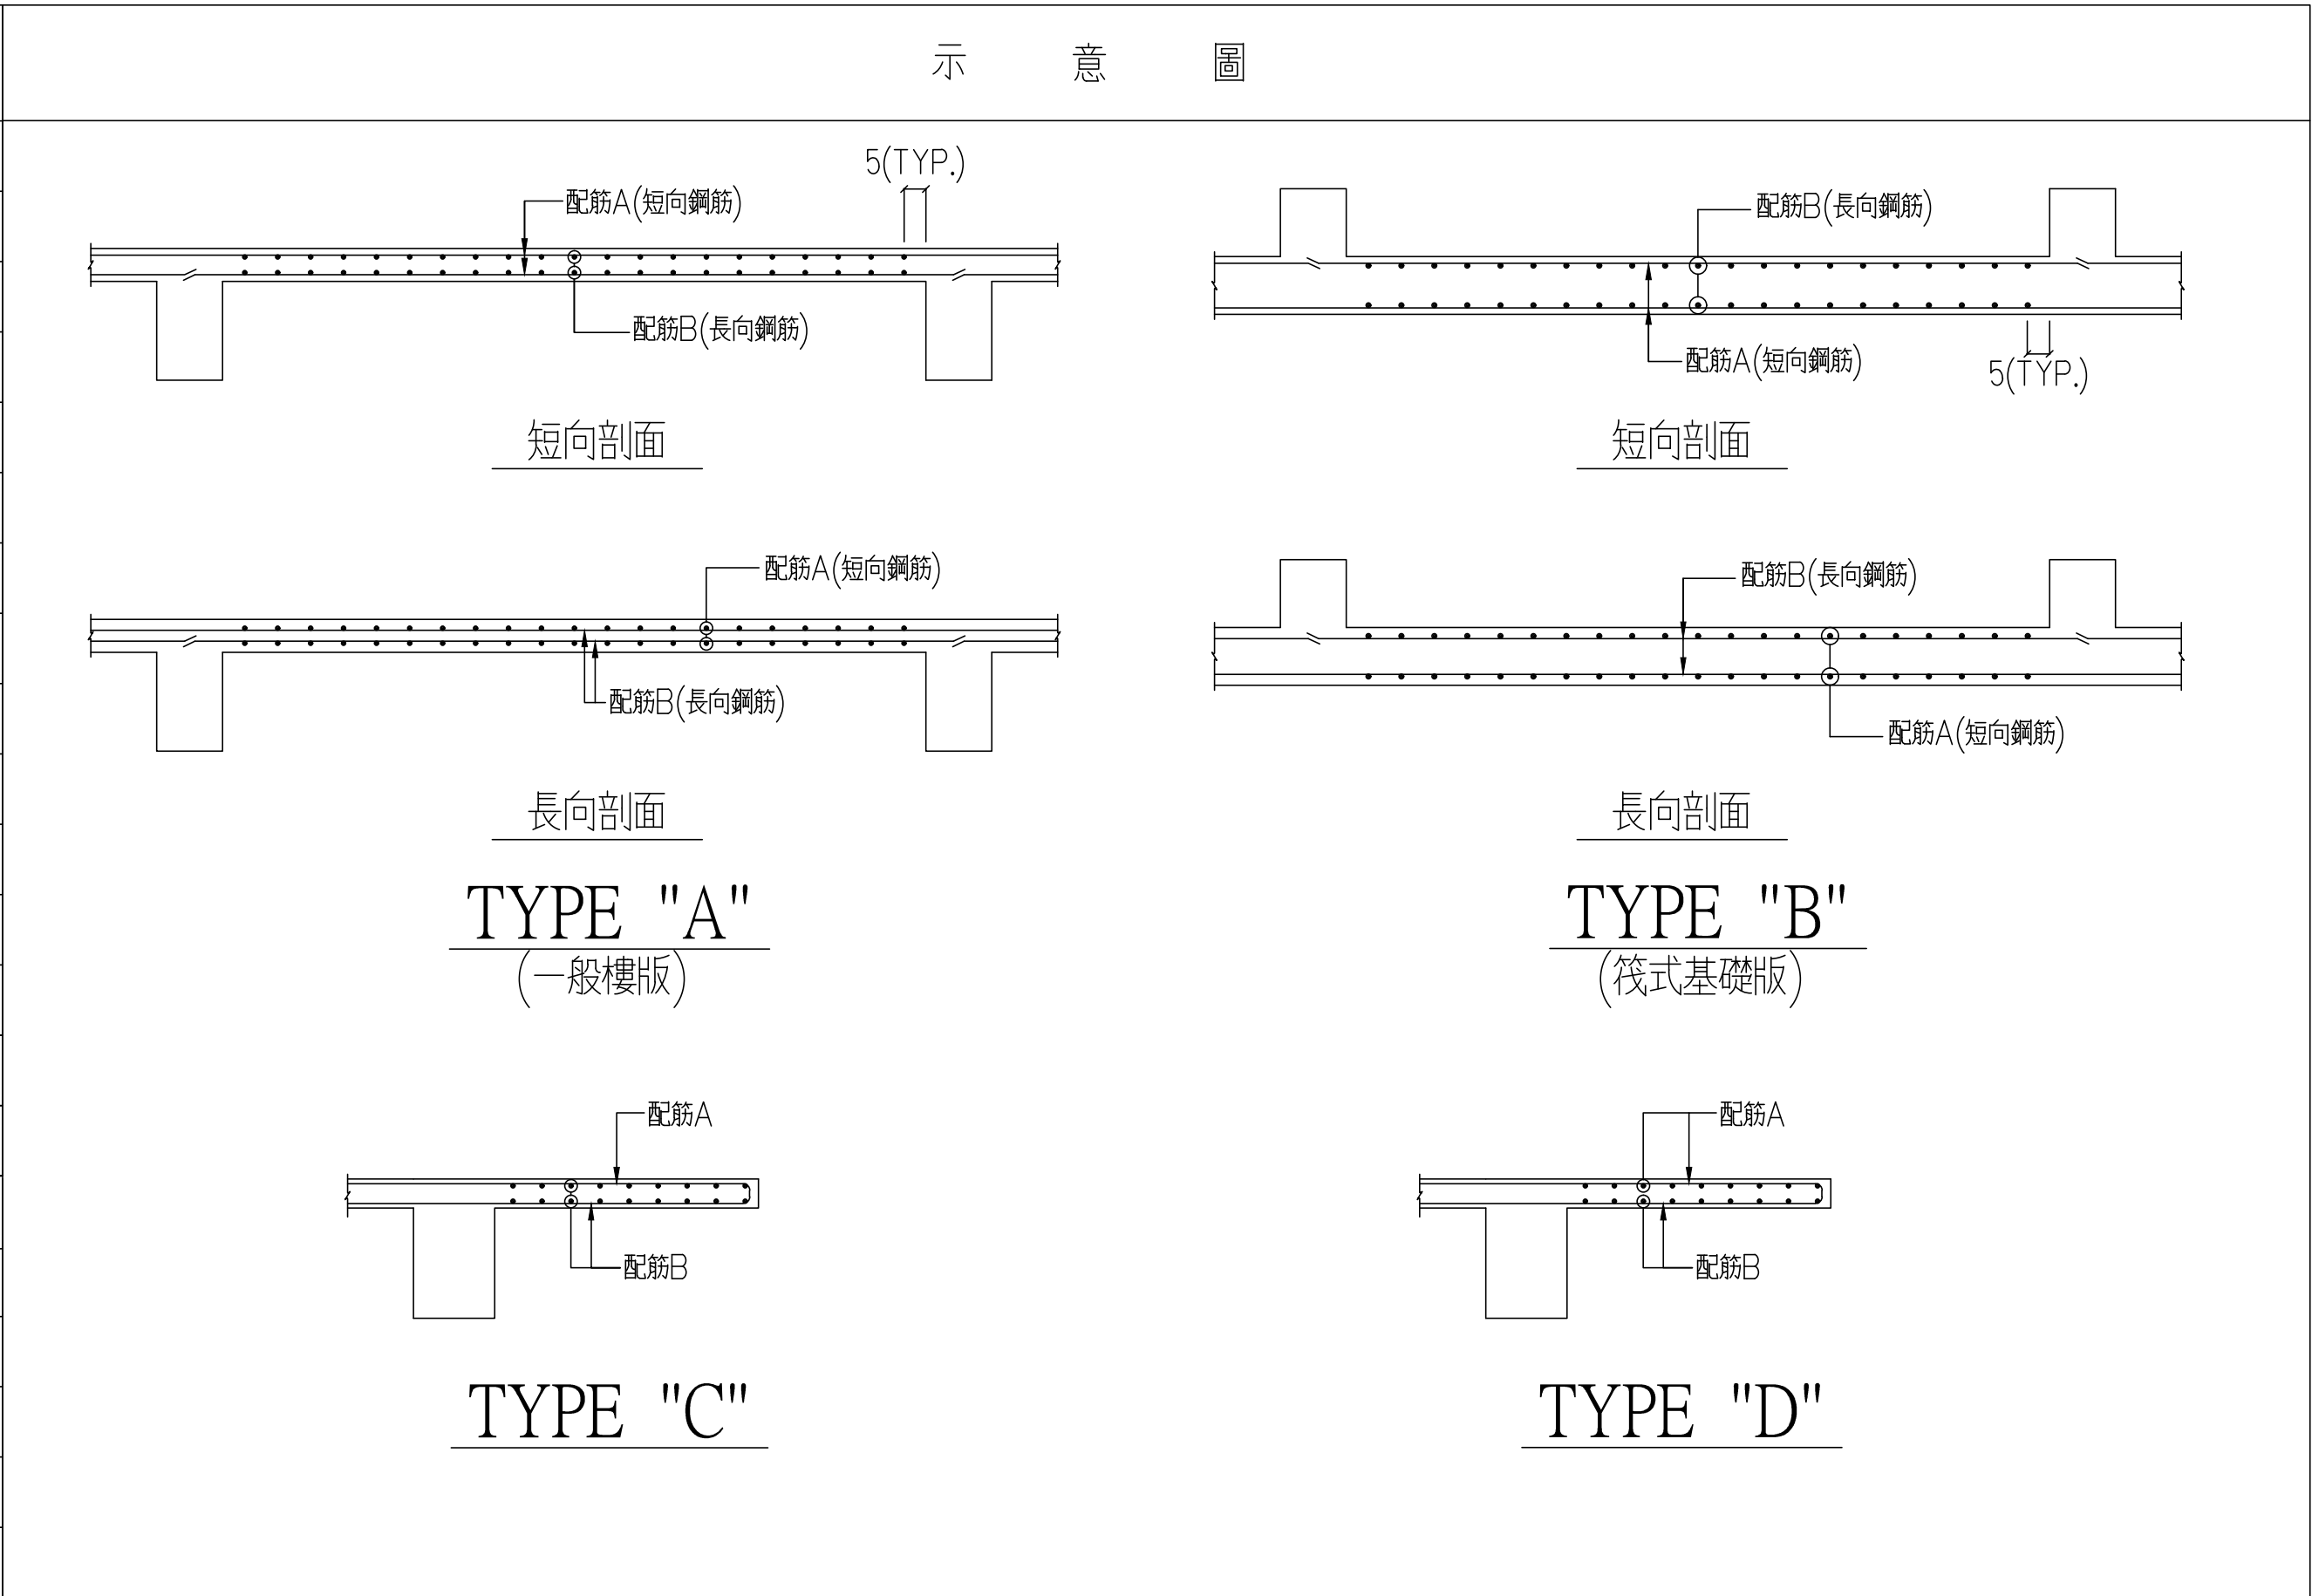

電梯牆配筋圖

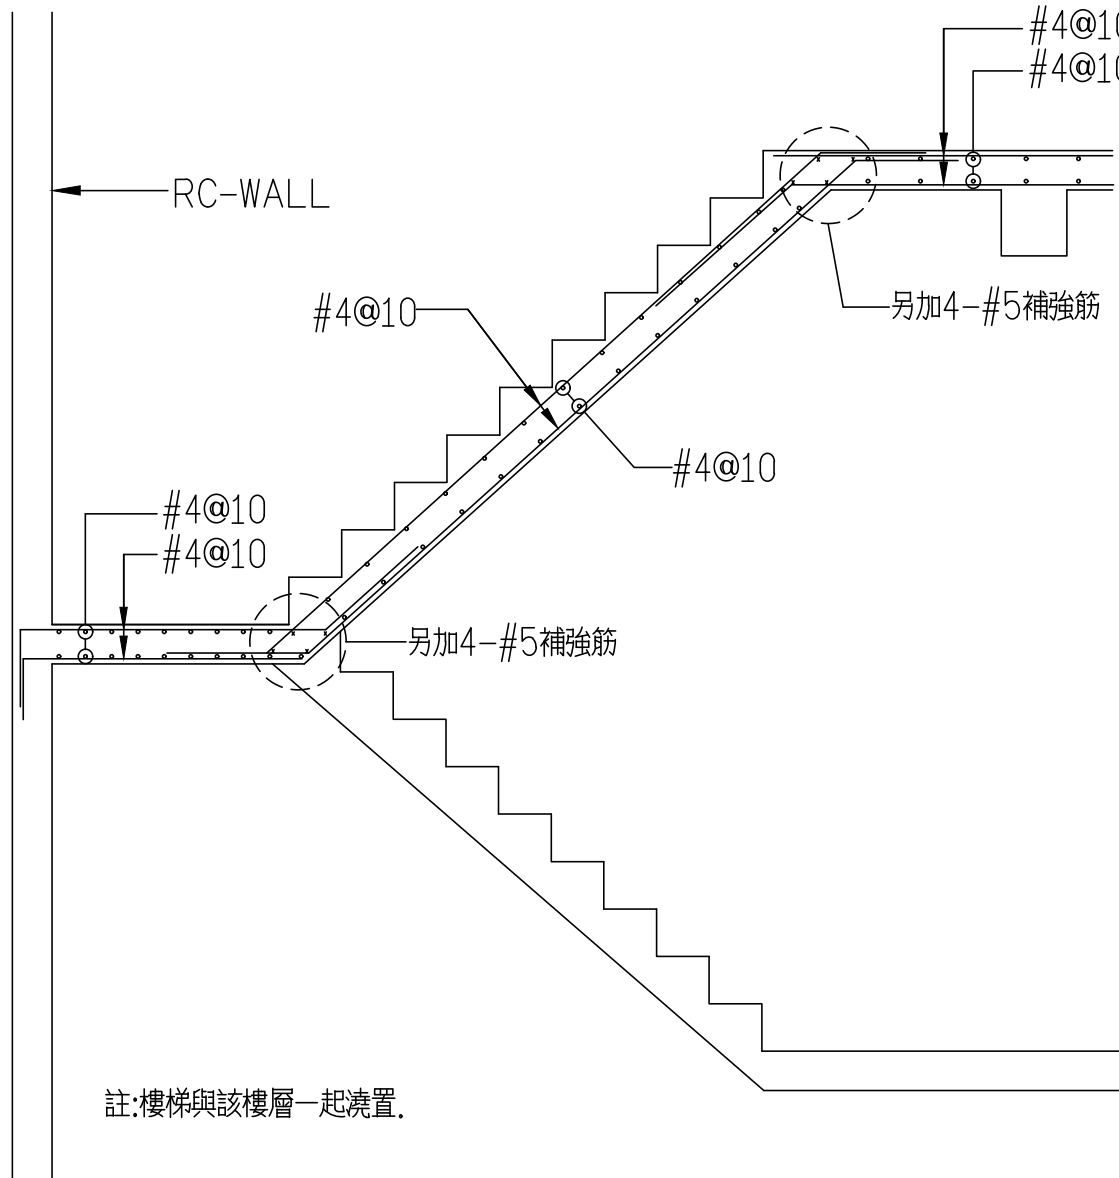


鋼筋混凝土樓梯配筋圖 t=20cm

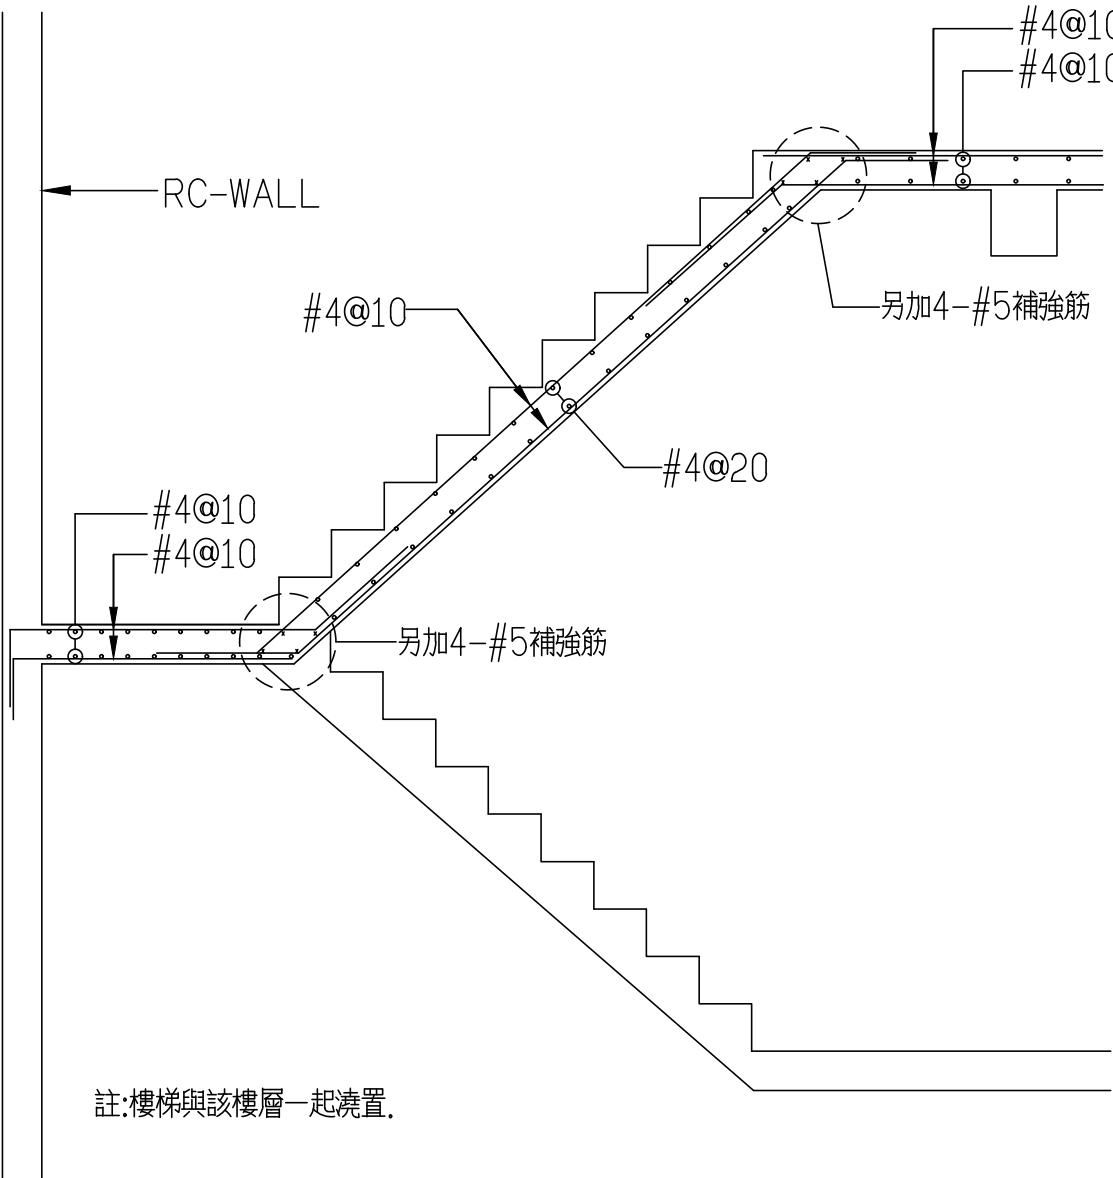

鋼筋混凝土樓梯配筋圖 t=15cm

牆厚 (cm)		單排 (cm)	雙排 (cm)	電梯牆雙排
10	VERT. HORI.	#3@10 #3@15		
12	VERT. HORI.	#3@10 #3@15	#3@15 #3@20	
15 16	VERT. HORI.		#3@15 #3@20	#4@10 #3@15
18 20	VERT. HORI.		#4@20 #4@20	#4@10 #4@15
25	VERT. HORI.		#4@15 #4@20	
30	VERT. HORI.		#4@15 #4@15	
35	VERT. HORI.		#4@12 #4@12	
40	VERT. HORI.		#5@15 #5@15	

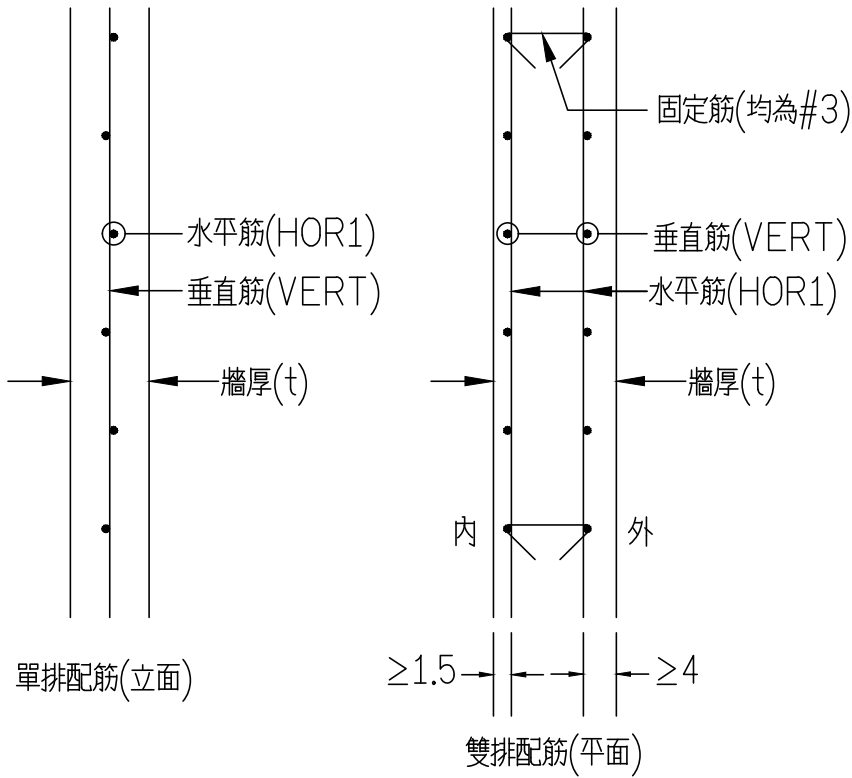

說明: 1.RC牆配筋,除另有註明者外,皆以上表為準.
2.12cm做為內隔牆時,可用單排配筋,若為外牆時則須雙排配筋.
3.固定筋之水平間距為垂直筋間距之5倍,垂直間距為水平筋間距之4倍.
4.牆垂直筋與水平筋端部均須埋入梁或柱內至少 l_d 之長度.
5.牆開口四週,應依開口補強配筋標準圖配置補強筋.